



## NOTES: 1. SOME ITEMS REMOVED FOR CLARITY.

			UNLESS OTHERWISE SPECIFIED  DIMENSIONS ARE IN INCHES AND  TOLERANCES ARE AS FOLLOWS  X° ±1°  .X ± .50  .XX ± .25	DESCRIPTION BIOSTORM 10.0 FLOW DIAGRAM	
			DATE: 4/12/2024  APPROVED BY:		
	SCALE: 1:35	SIZE:	AZ APPROVED BY DATE: 4/12/2024	PART NUMBER BIOSTORM 10.0	REV A

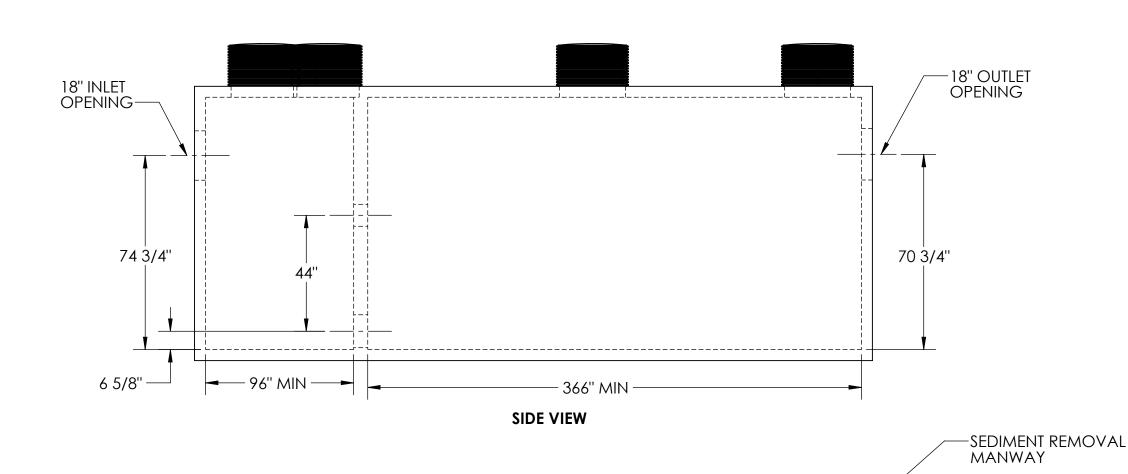

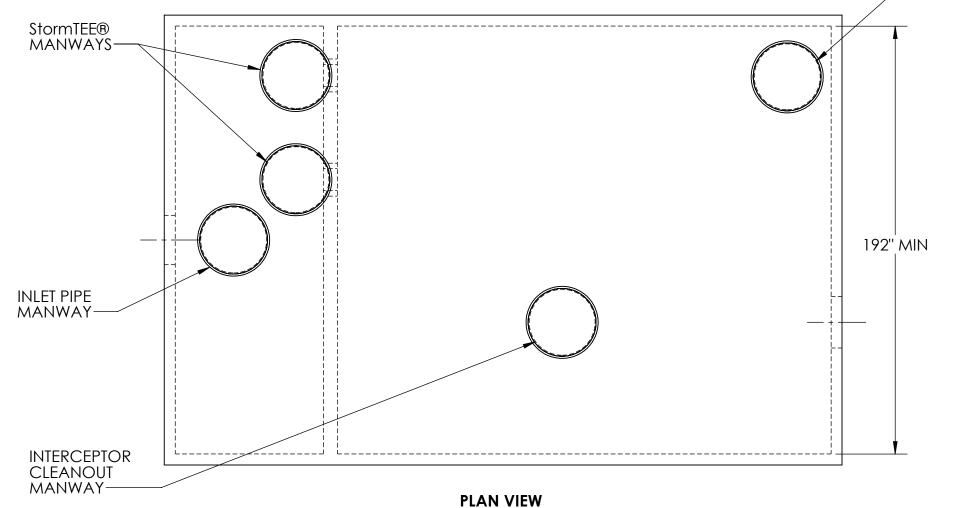

## **NOTES:**

- 1. SOME ITEMS ARE REMOVED FOR CLARITY.
- 2. INLET PIPE MUST BE INSTALLED AT A WIDTH EQUIVALENT TO HALF OF THE PRIMARY TREATMENT CHAMBER WIDTH.
- 3. INTERCEPTOR CLEANOUT CAN BE SIZED AS 8", 16" OR 24".
- 4. A 24" StormTEE MANWAY AND SEDIMENT REMOVAL MANWAY IS REQUIRED.
- 5. INTERCEPTOR CLEANOUT MANWAY MUST BE CENTERED ABOVE THE INTERCEPTOR.
- 6. BIOMICROBICS RECOMMENDS A 1-2% PIPE SLOPE INTO THE SYSTEM AND BEFORE THE INVERT.
- 7. DEPENDING ON PROJECT REQUIREMENTS, PRIMARY AND SECONDARY CHAMBERS MAY BE CONSTRUCTED SEPARATELY.
- 8. TOTAL FOOT ASSEMBLY HEIGHT SHOULD NOT BE LESS THAN 12 INCHES.
- 9. BRACING SUPPORT IS REQUIRED TO SUPPORT THE HOUSING FOR BIOSTORM MODELS 5.0 AND 10.0

PROPRIETARY AND CONFIDENTI THE INFORMATION CONTAINED IN DRAWING IS THE SOLE PROPERTY BIO-MICROBICS, INC., ANY REPRODUCTION IN PART OR AS A WITHOUT THE WRITTEN PERMISSION BIO-MICROBICS, INC. IS	OF DIMENSIONS ARE IN INCHES AND TOLERANCES ARE AS FOLLOWS  WHOLE TOUR AND TOLERANCES ARE AS FOLLOWS  X° ±1°  Y + 50	BIO MICROBICS  BETTER WATER, BETTER WORLD.	
PROHIBITED.	DRAWN BY:		
	ESG	DESCRIPTION	
DO NOT SCALE DRAWING	DATE: 4/12/2024	BIOSTORM 10.0 TANK DETAILS	
SHEET 3 OF 4	APPROVED BY:	DLIMILS	
	AZ	PART NUMBER	REV
SCALE: 1:35 SIZE: B	APPROVED BY DATE: 4/12/2024	BIOSTORM 10.0	Α

