




REVISIONS		
REV.	DESCRIPTION	DATE
C	RELEASED TO CURRENT	5/27/2021








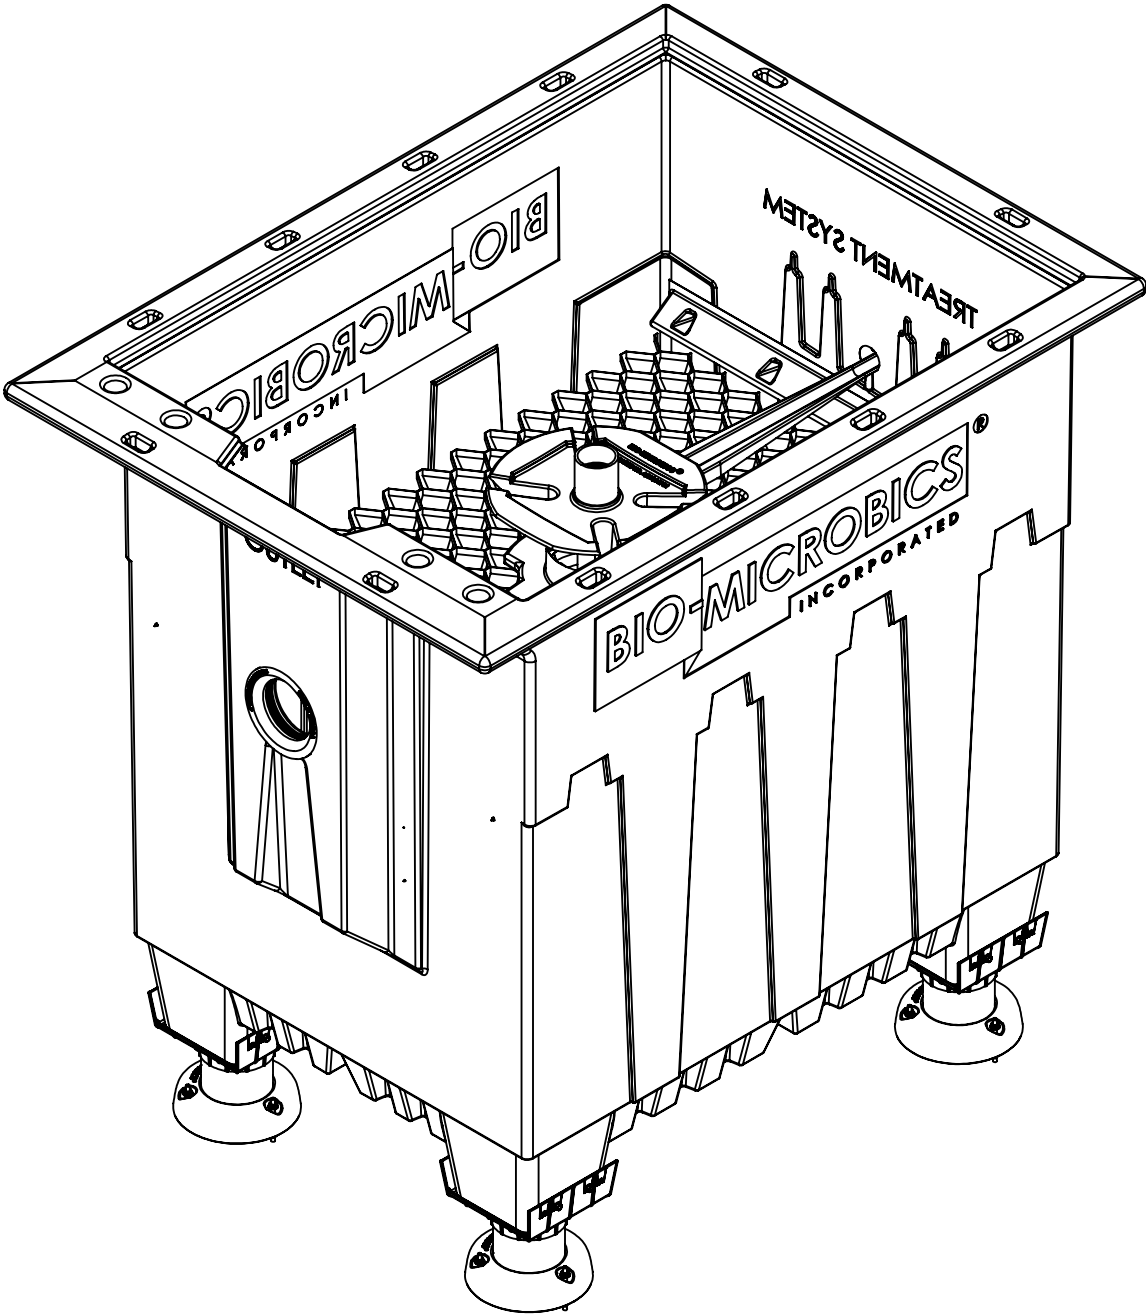


NitriFAST® 0.75 WITH FEET

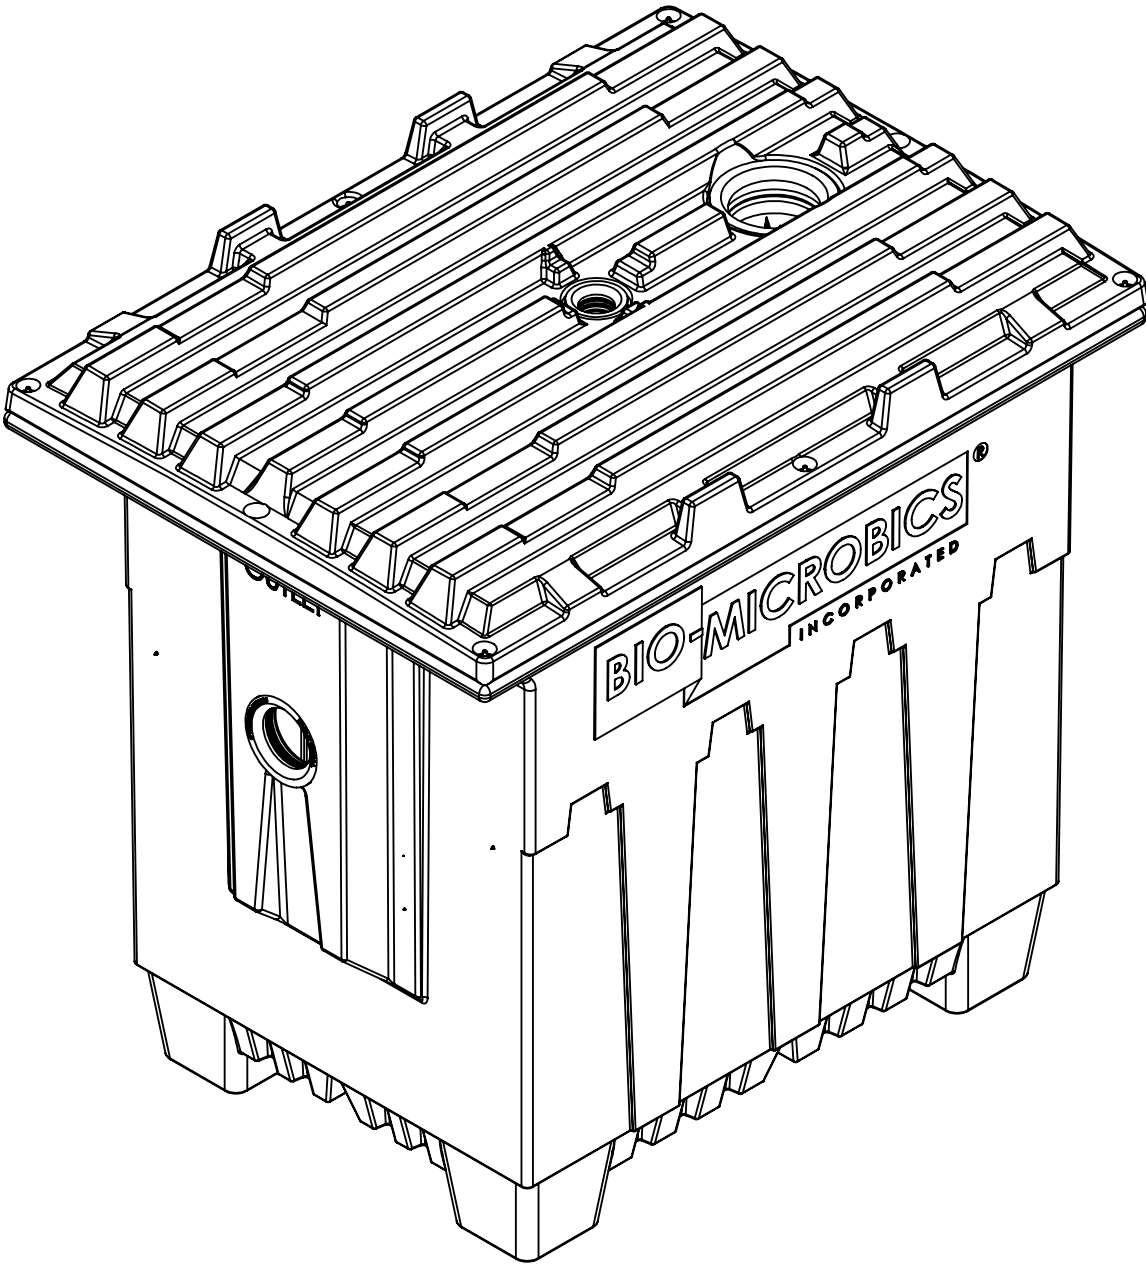


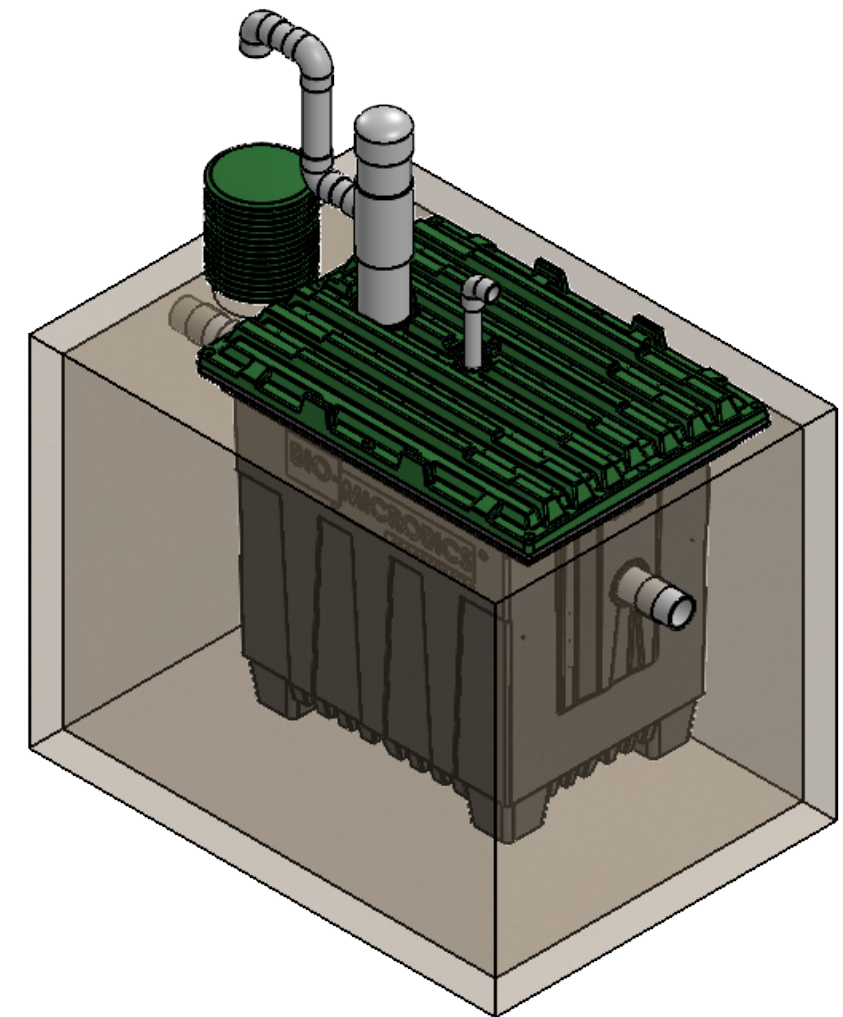
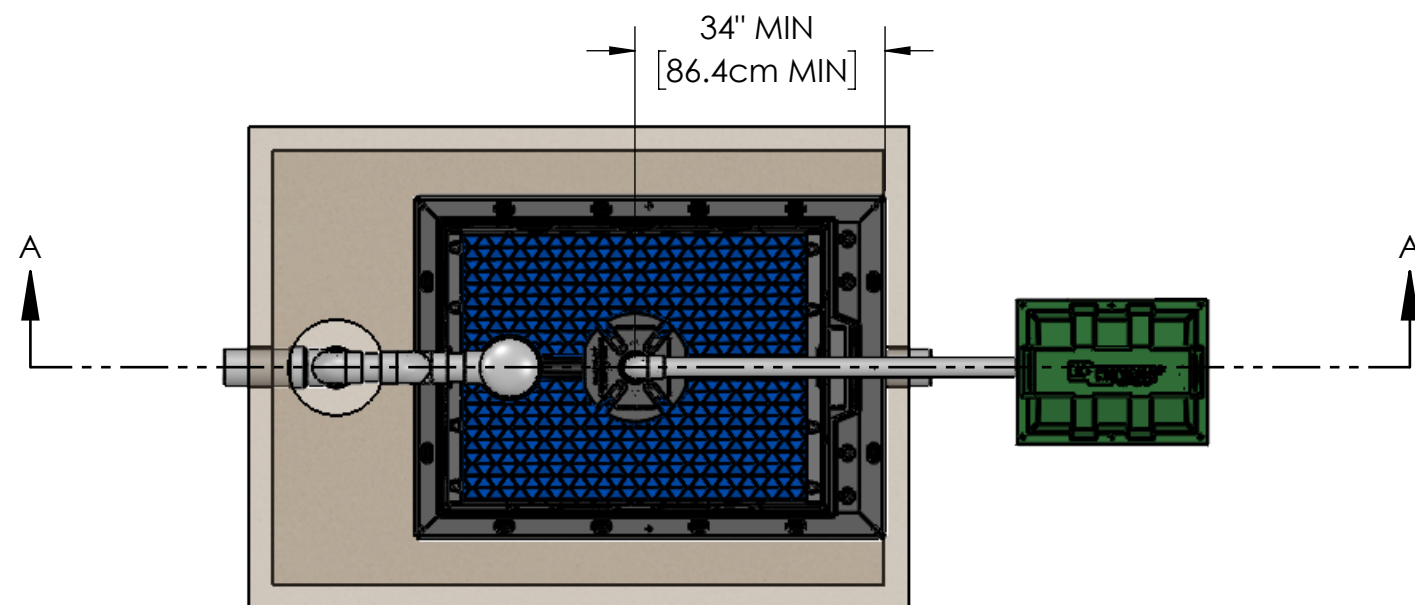
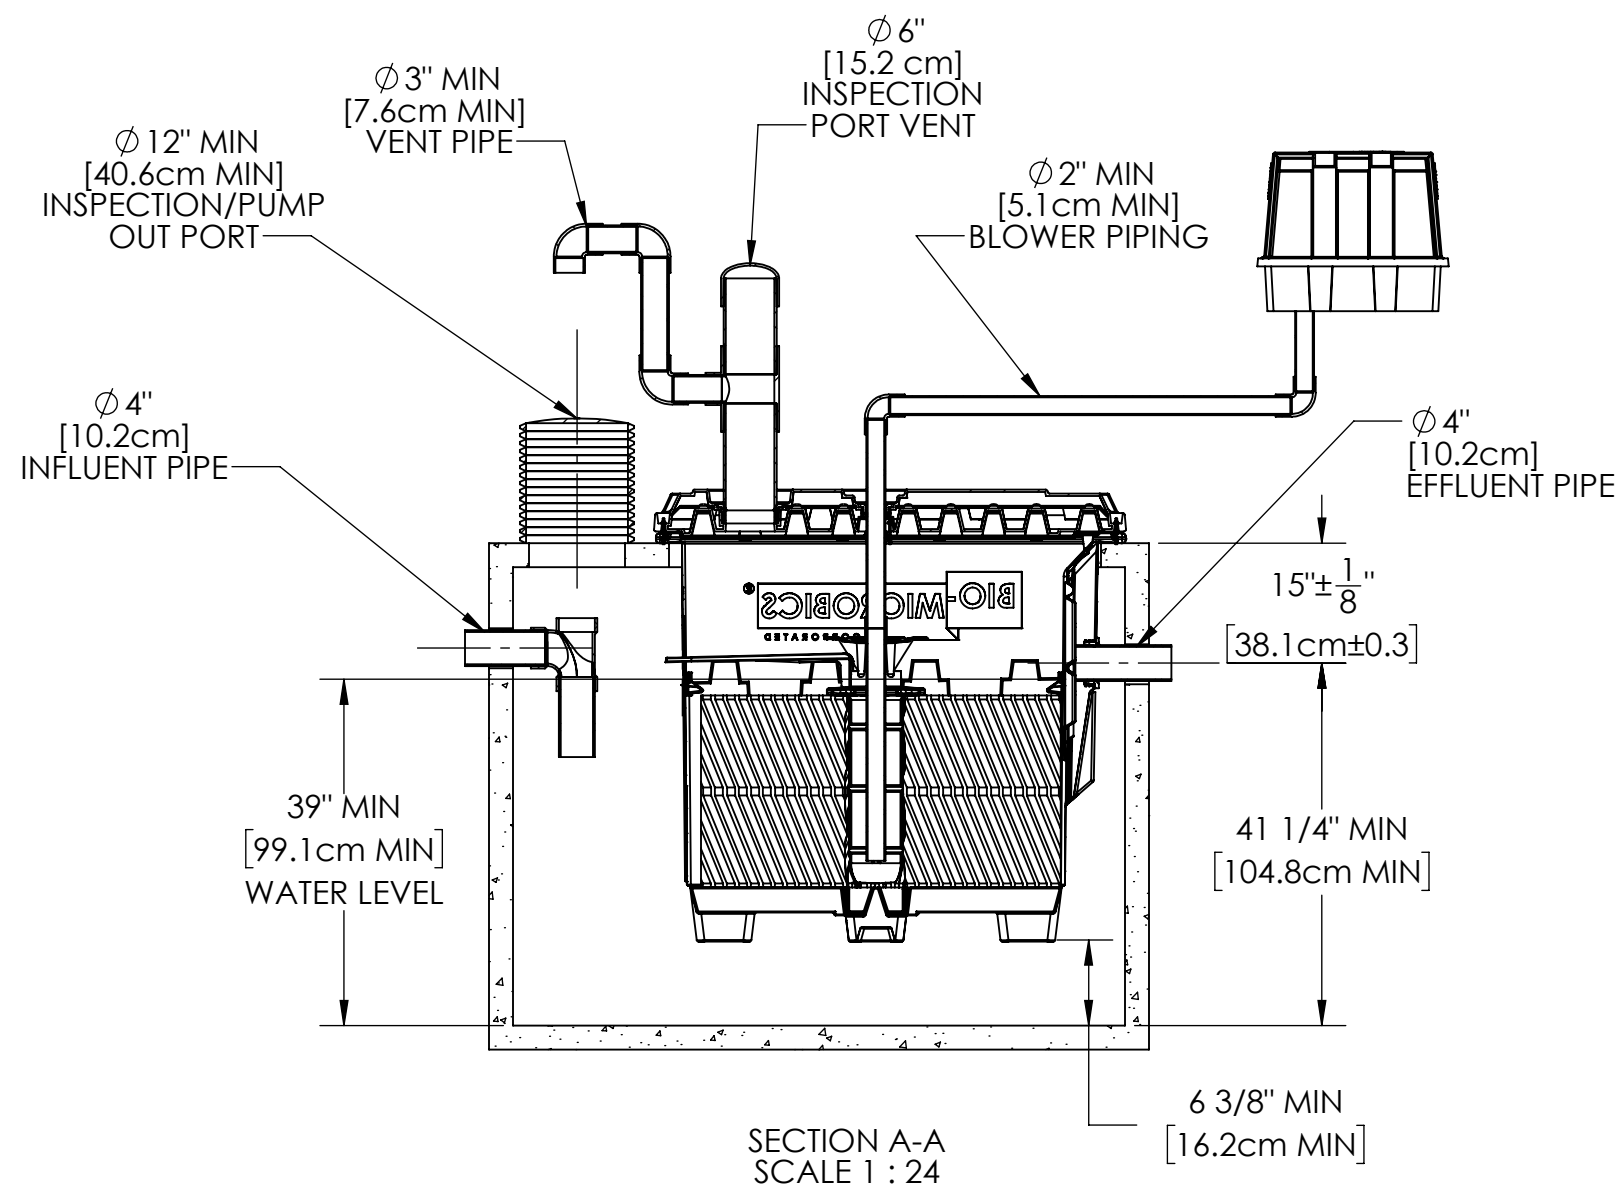
NitriFAST® 0.75 WITH LID

PROPRIETARY AND CONFIDENTIAL THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF BIOMICROBICS, INC.. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF BIOMICROBICS, INC. IS PROHIBITED. DO NOT SCALE DRAWING		UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES AND TOLERANCES ARE AS FOLLOWS X° ±1° .X ± .50 .XX ± .25			
		DRAWN BY: CTD			
		DATE: 5/27/2021		DESCRIPTION NITRIFAST 0.75 UNIT VIEWS	
SHEET 1 OF 6		APPROVED BY: MSH		PART NUMBER	
SCALE: 1:24	SIZE: B	APPROVED DATE: 5/27/2021		600-FINNTF0.75	REV C

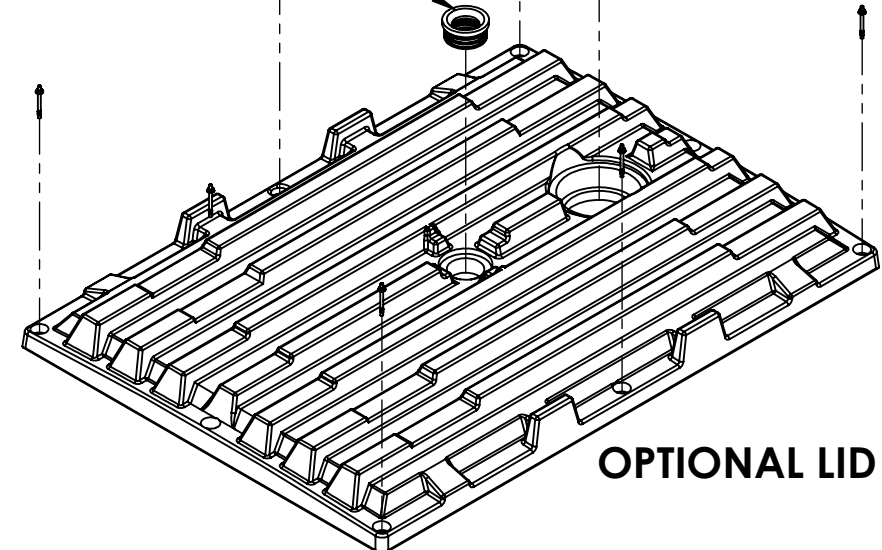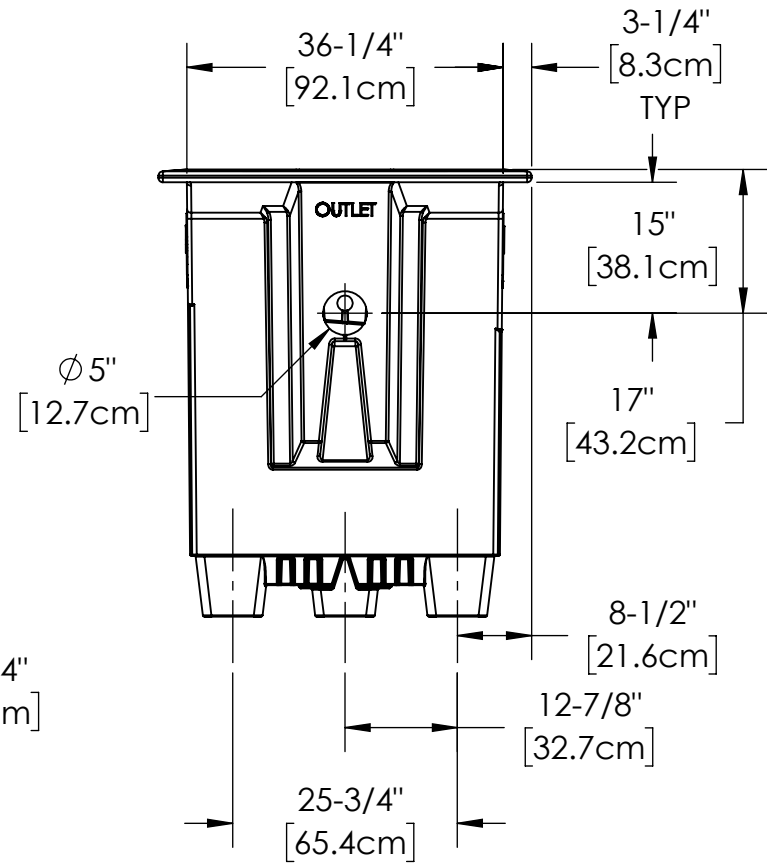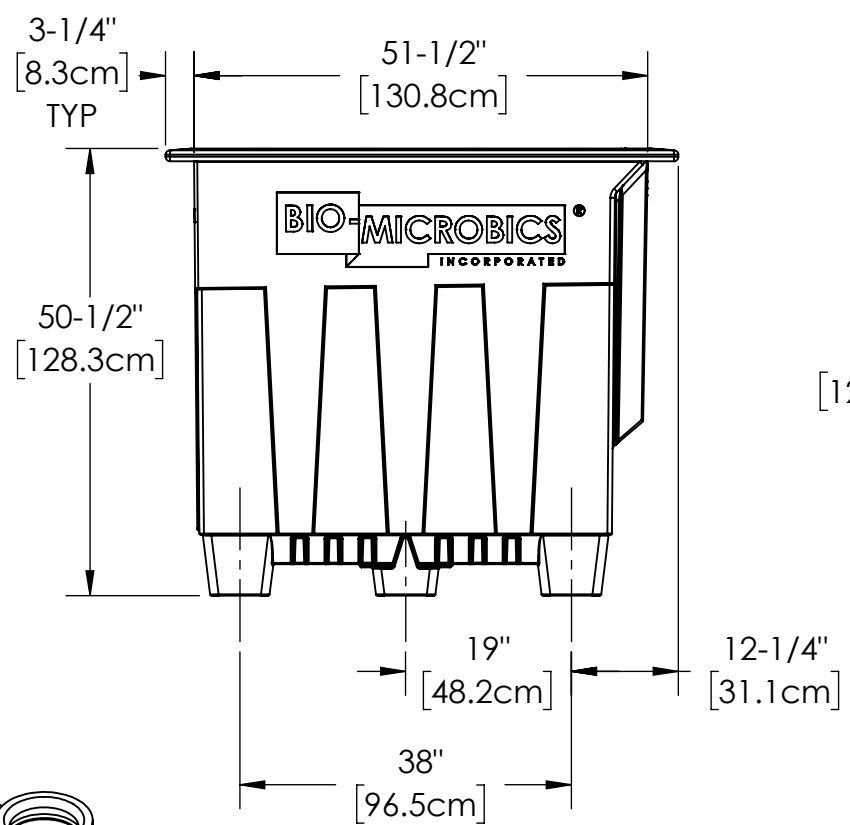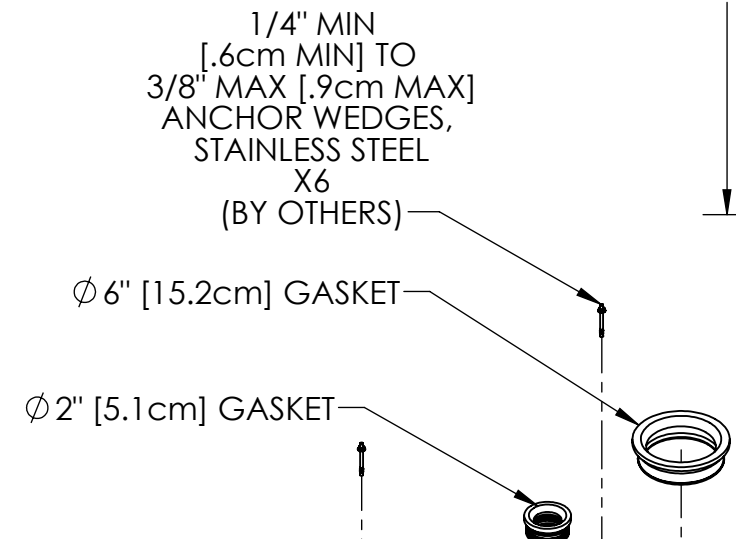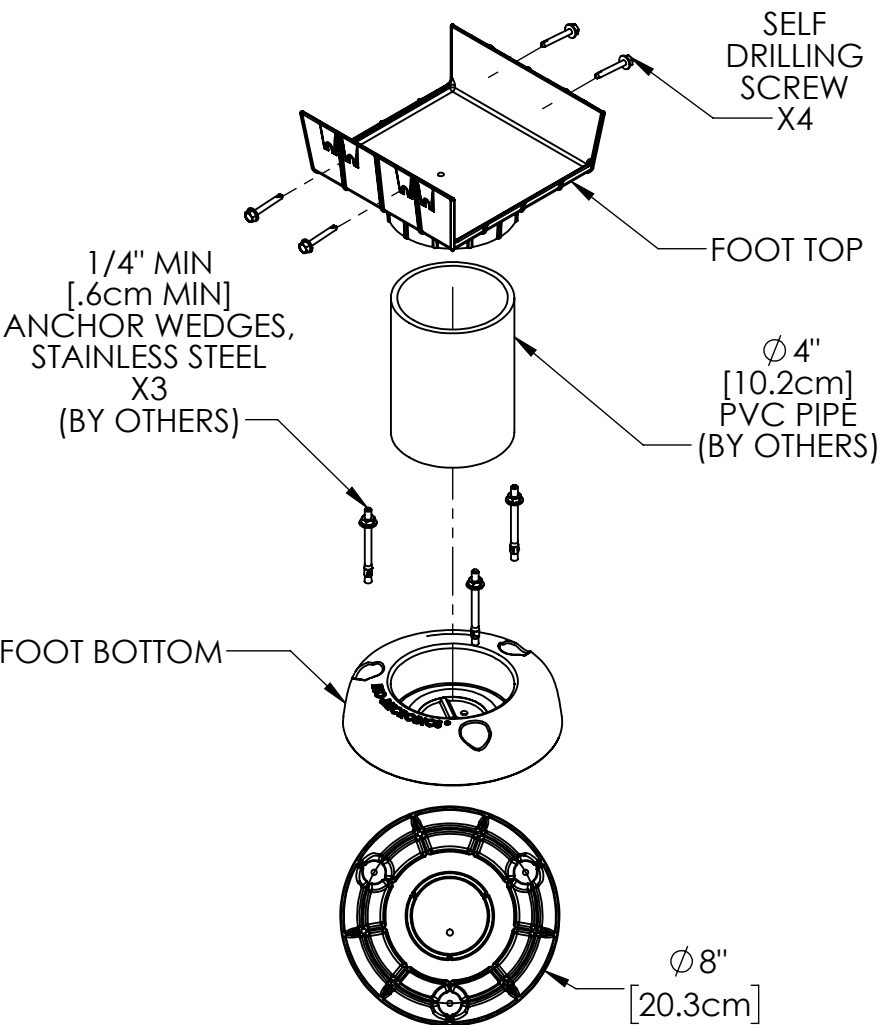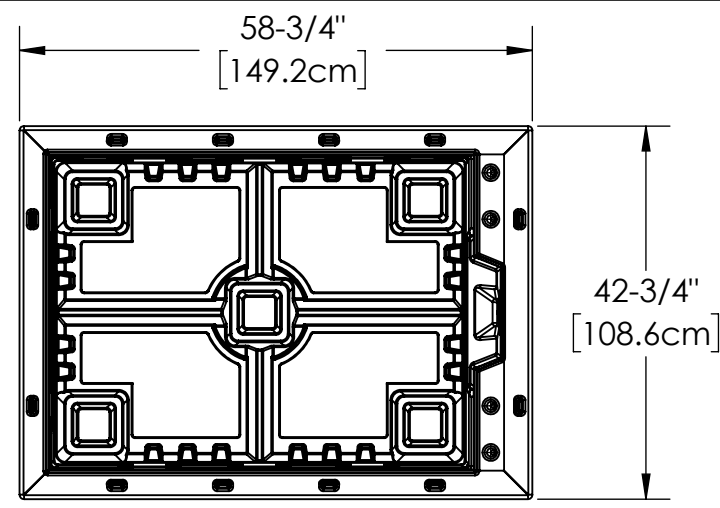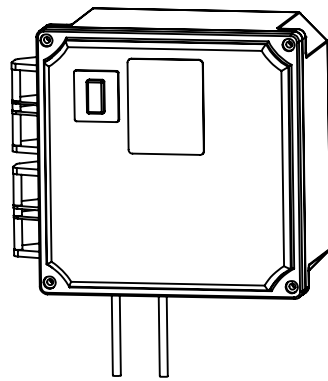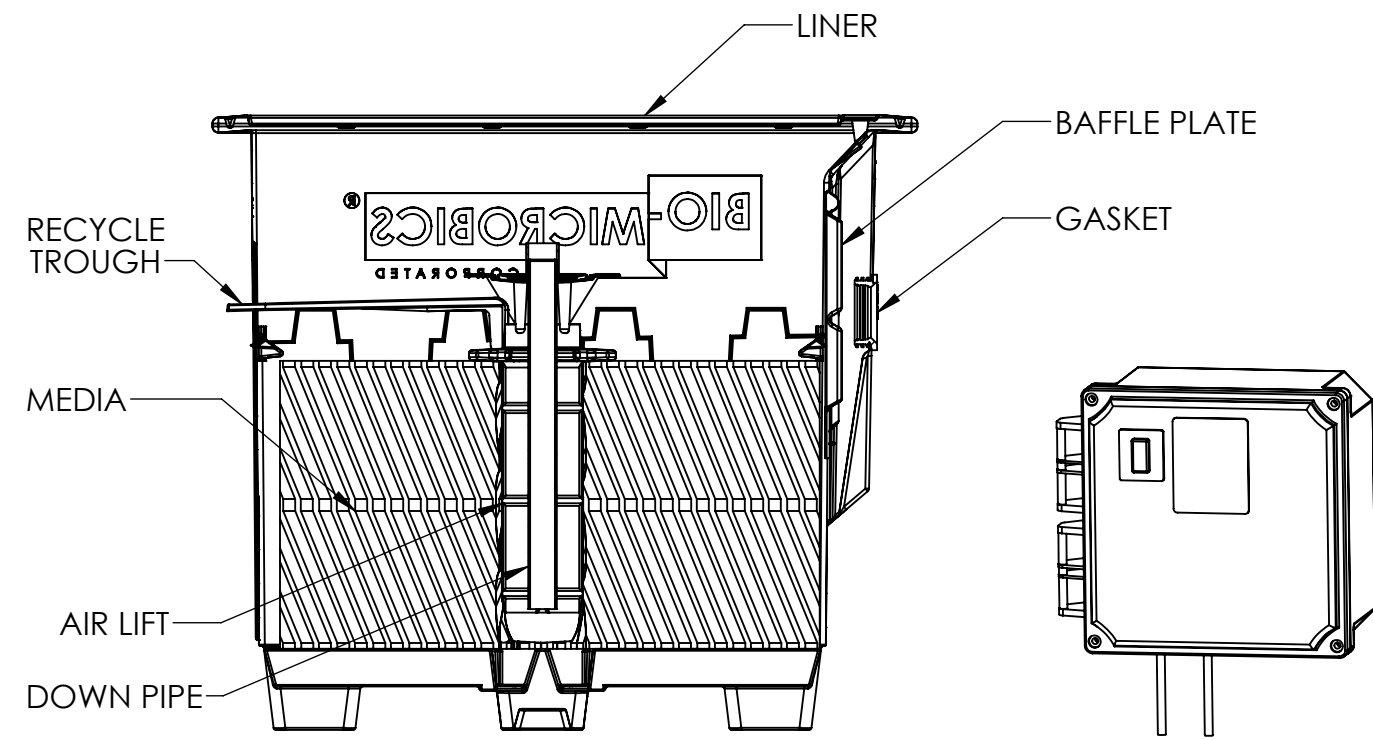

NOTES:
1. ITEMS ARE DEPICTIONS AND MAY VARY IN APPEARANCE.




PROPRIETARY AND CONFIDENTIAL THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF BIOMICROBICS, INC.. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF BIOMICROBICS, INC. IS PROHIBITED. DO NOT SCALE DRAWING			UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES AND TOLERANCES ARE AS FOLLOWS X° ± 1° .X ± .50 .XX ± .25		 BETTER WATER. BETTER WORLD.
SHEET 2 OF 6			DRAWN BY: CTD	DATE: 5/27/2021	
SCALE: 1:32			APPROVED BY: MSH	APPROVED DATE: 5/27/2021	DESCRIPTION NITRIFAST 0.75 UNIT DETAILS
SIZE: B			PART NUMBER 600-FINNTF0.75		REV C



NOTES:


1. AIRLINE PIPING TO FAST® SHOULD NOT EXCEED 100 FT (30M) TOTAL LENGTH AND SHOULD HAVE A MAXIMUM OF 4 ELBOWS IN THE PIPING SYSTEM. FOR DISTANCES GREATER THAN 100 FT (30M) CONSULT FACTORY.
2. IF LESS THAN THE SPECIFIED MINIMUMS ARE CONSIDERED NECESSARY, CONSULT FACTORY FOR GUIDANCE.
3. SPECIALIZED TREATMENT NEEDS MAY REQUIRE SPECIFIC FEATURES TO BE INCORPORATED INTO THE DESIGN. CONSULT FACTORY FOR GUIDANCE.
4. SOME ITEMS REMOVED FOR CLARITY.
5. MINIMUM OF 2.0in [5.1cm] INVERT IS NECESSARY BETWEEN THE INLET AND OUTLET OF EACH ZONE FOR GRAVITY FLOW SYSTEMS.





PROPRIETARY AND CONFIDENTIAL THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF BIOMICROBICS, INC.. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF BIOMICROBICS, INC. IS PROHIBITED. DO NOT SCALE DRAWING		UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES AND TOLERANCES ARE AS FOLLOWS $X^{\circ} \pm 1^{\circ}$ $.X \pm .50$ $.XX \pm .25$	
		DRAWN BY: CTD	BIO MICROBICS BETTER WATER. BETTER WORLD.
SHEET 3 OF 6		DATE: 5/27/2021	DESCRIPTION NITRIFAST 0.75 UNIT WITH LID
SCALE: 1:32	SIZE: B	APPROVED BY: MSH	PART NUMBER 600-FINNTF0.75
		APPROVED DATE: 5/27/2021	REV C

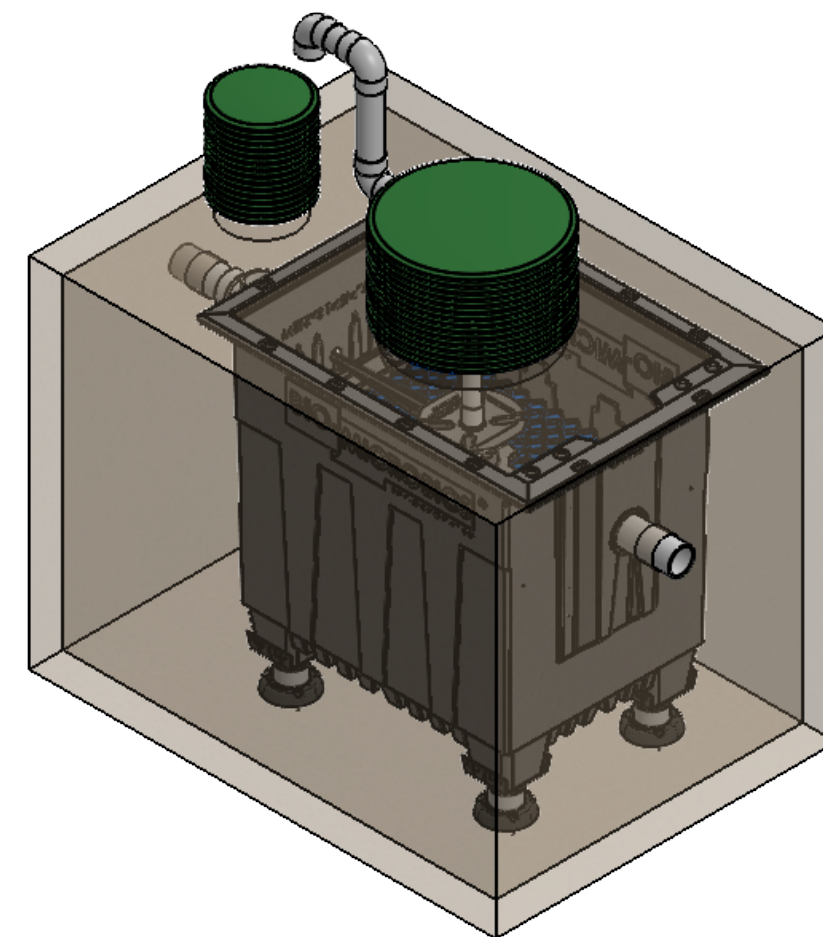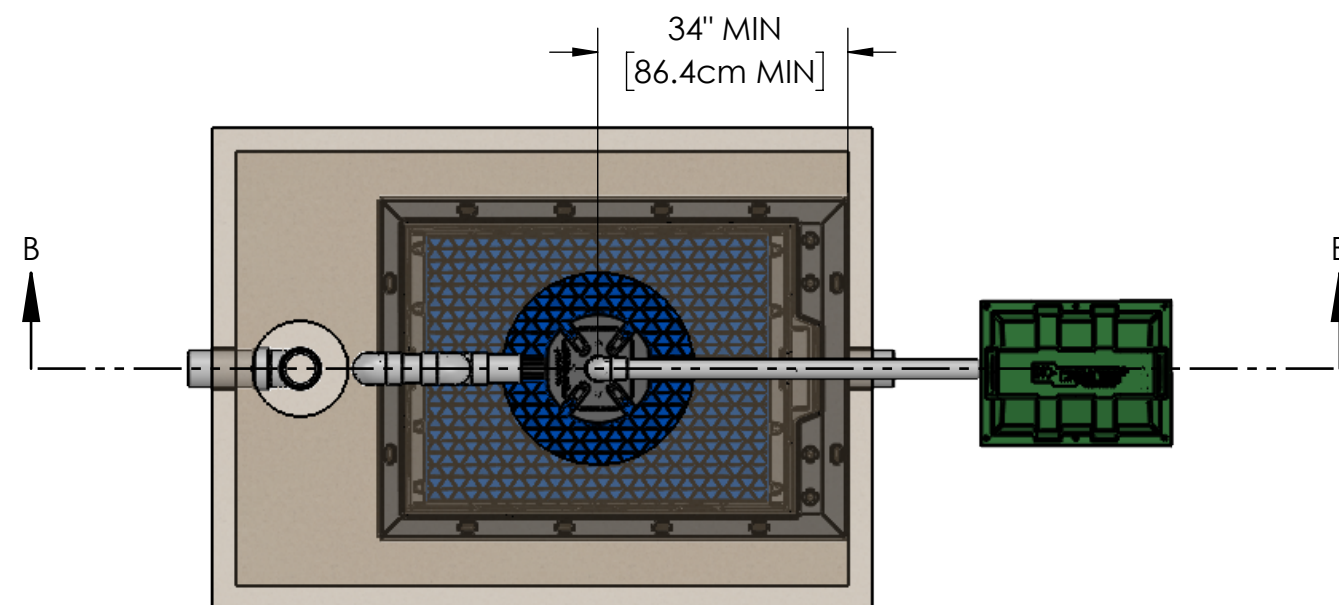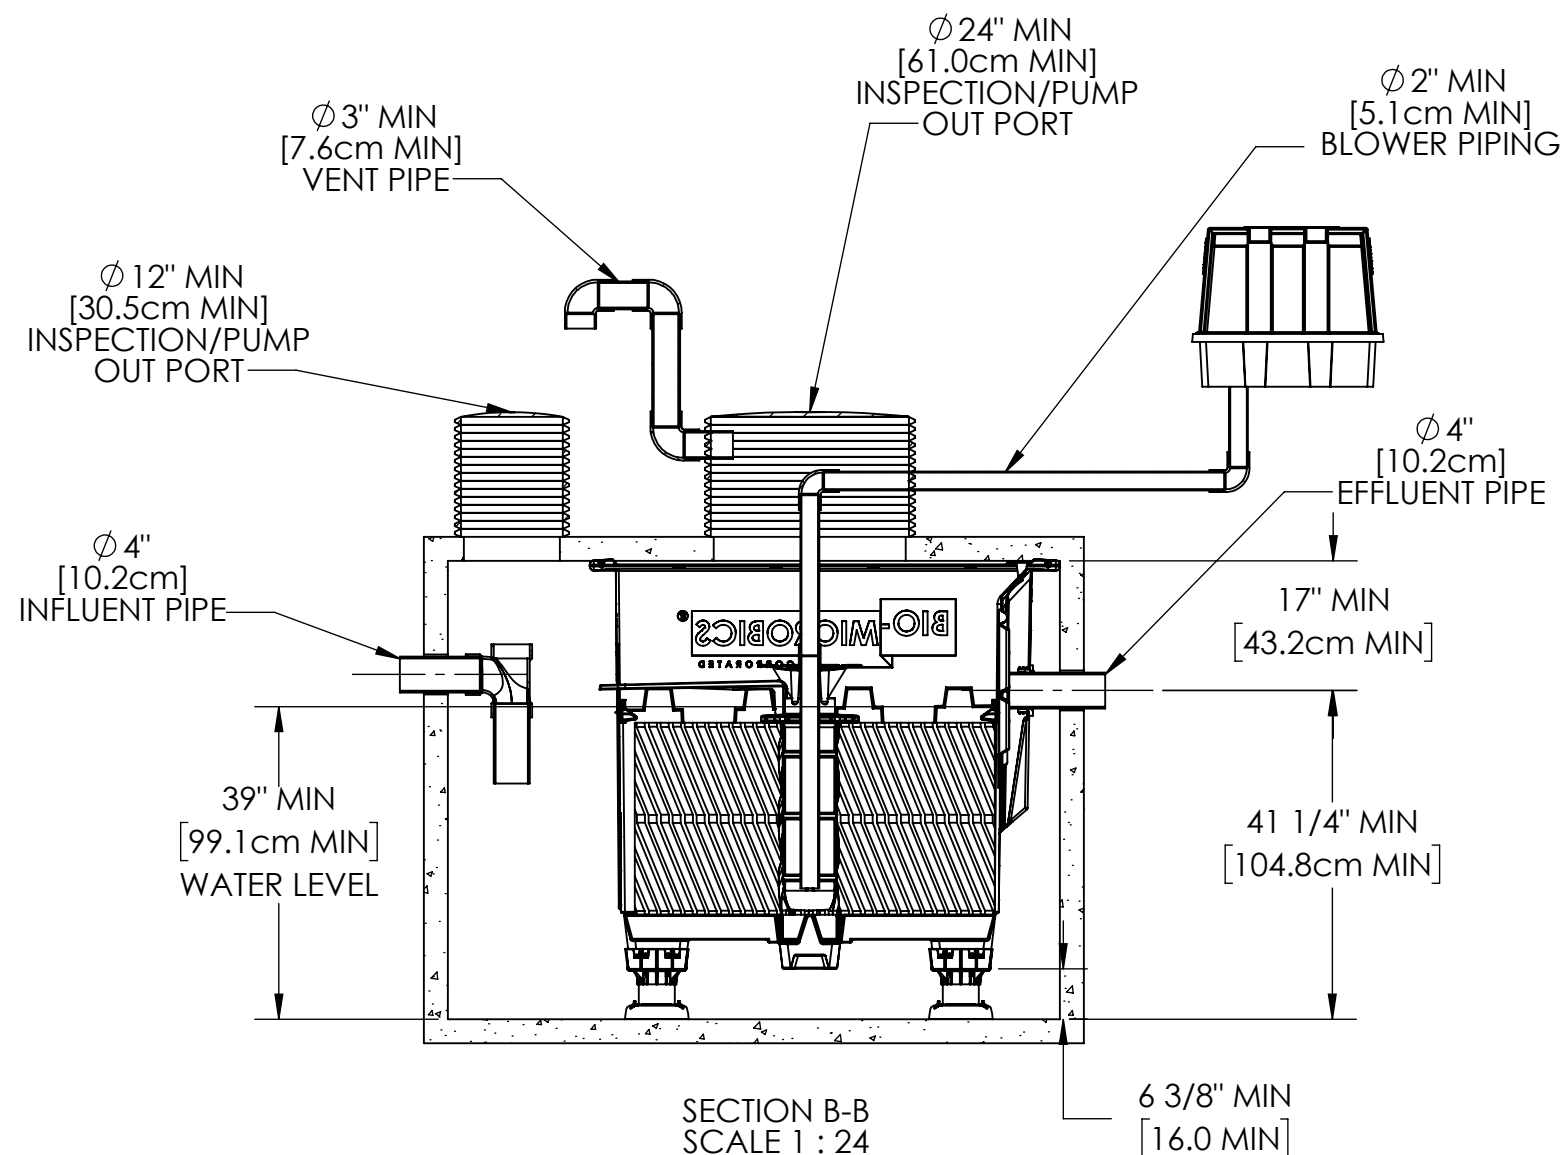

NOTES:


1. AIRLINE PIPING TO FAST® SHOULD NOT EXCEED 100 FT (30M) TOTAL LENGTH AND SHOULD HAVE A MAXIMUM OF 4 ELBOWS IN THE PIPING SYSTEM. FOR DISTANCES GREATER THAN 100 FT (30M) CONSULT FACTORY.
2. IF LESS THAN THE SPECIFIED MINIMUMS ARE CONSIDERED NECESSARY, CONSULT FACTORY FOR GUIDANCE.
3. SPECIALIZED TREATMENT NEEDS MAY REQUIRE SPECIFIC FEATURES TO BE INCORPORATED INTO THE DESIGN. CONSULT FACTORY FOR GUIDANCE.
4. SOME ITEMS REMOVED FOR CLARITY.
5. MINIMUM OF 2.0in [5.1cm] INVERT IS NECESSARY BETWEEN THE INLET AND OUTLET OF TANK FOR GRAVITY FLOW SYSTEMS.



PROPRIETARY AND CONFIDENTIAL THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF BIOMICROBICS, INC., ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF BIOMICROBICS, INC. IS PROHIBITED. DO NOT SCALE DRAWING		UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES AND TOLERANCES ARE AS FOLLOWS X° ±1° .X ±.50 .XX ±.25			
		DRAWN BY: CTD			DESCRIPTION NITRIFAST 0.75 UNIT WITH FEET
		DATE: 5/27/2021			PART NUMBER 600-FINNTF0.75
		APPROVED BY: MSH			REV C
		APPROVED DATE: 5/27/2021			
SHEET 4 OF 6					
SCALE: 1:32	SIZE: B				

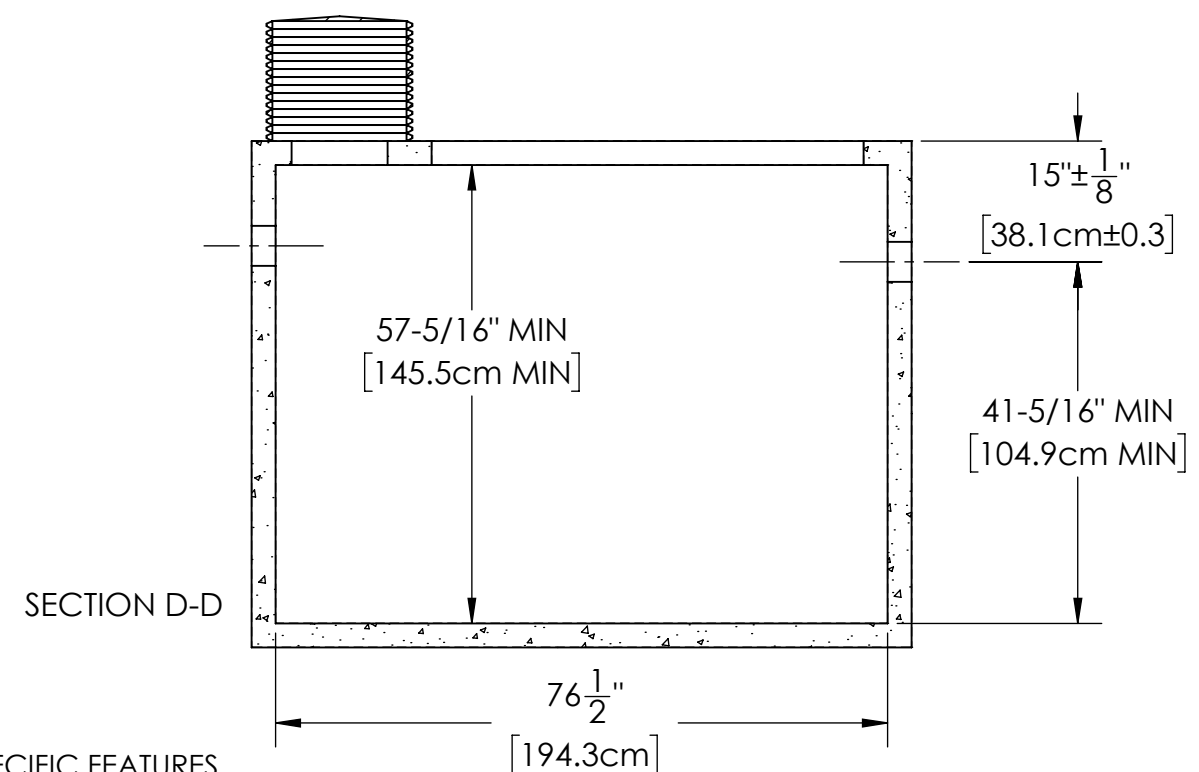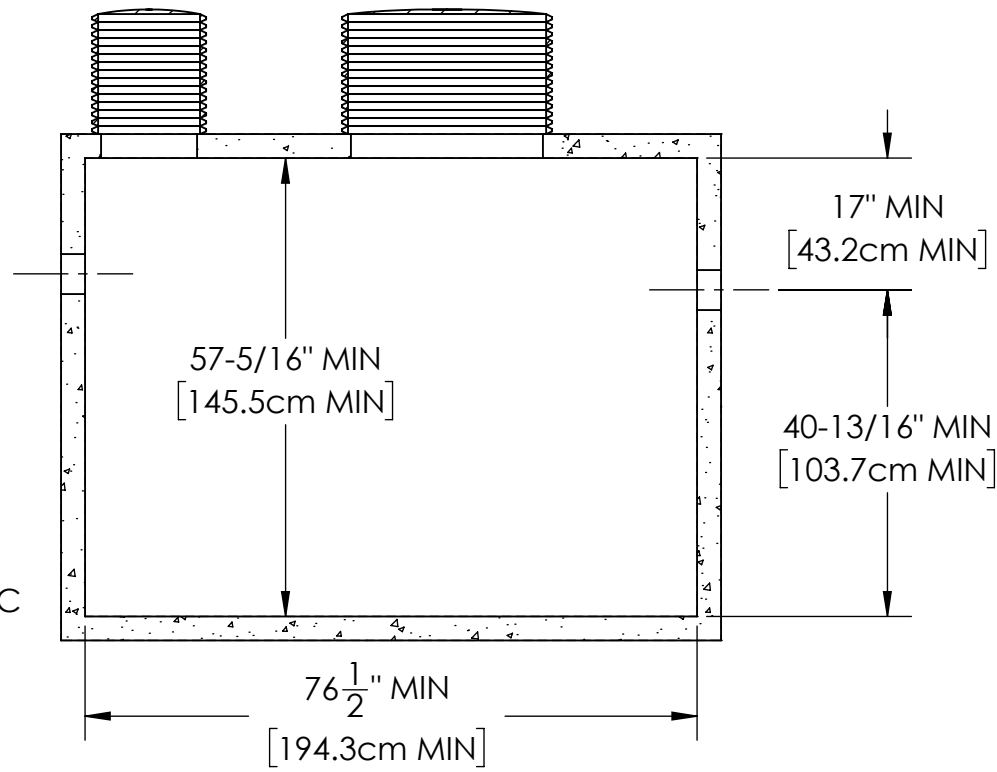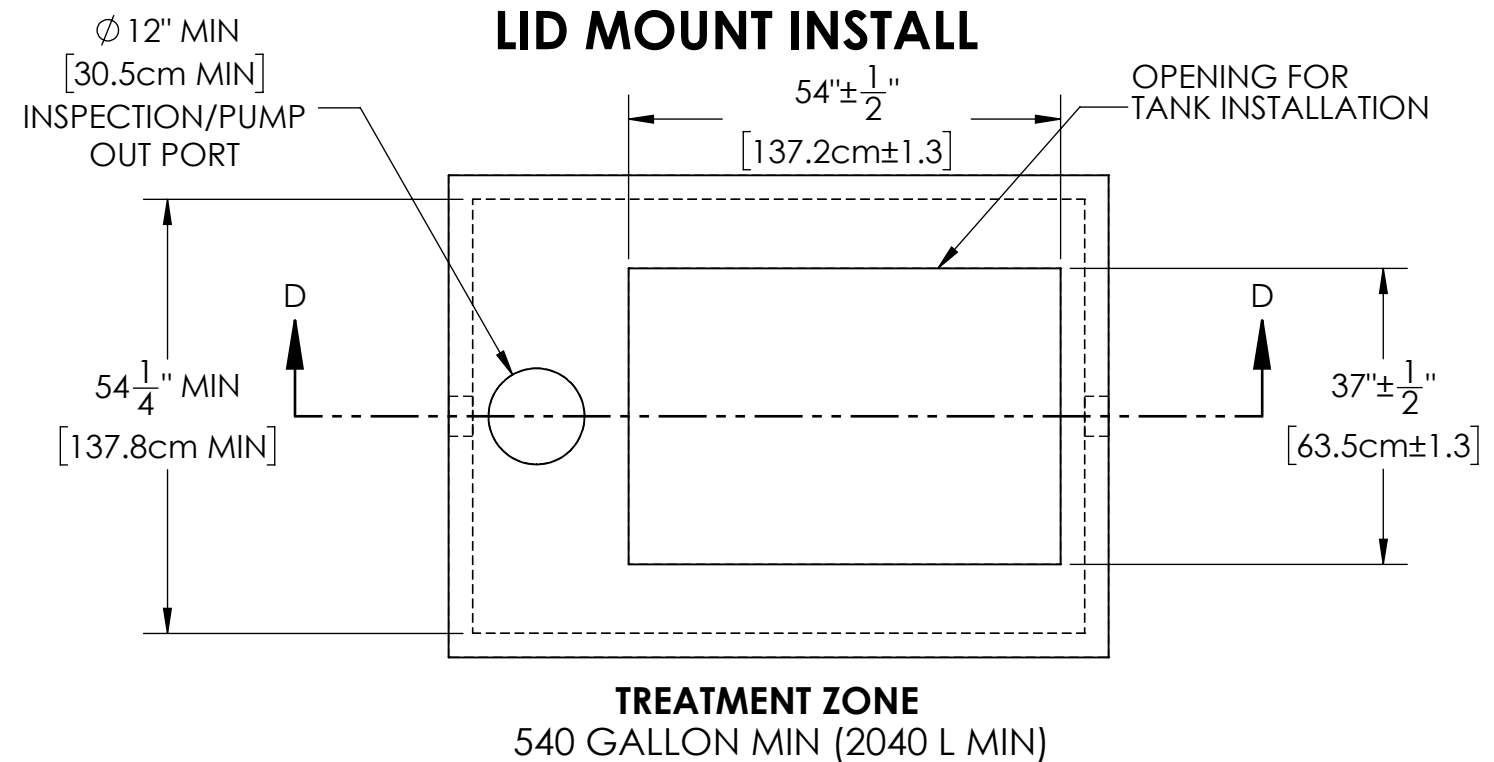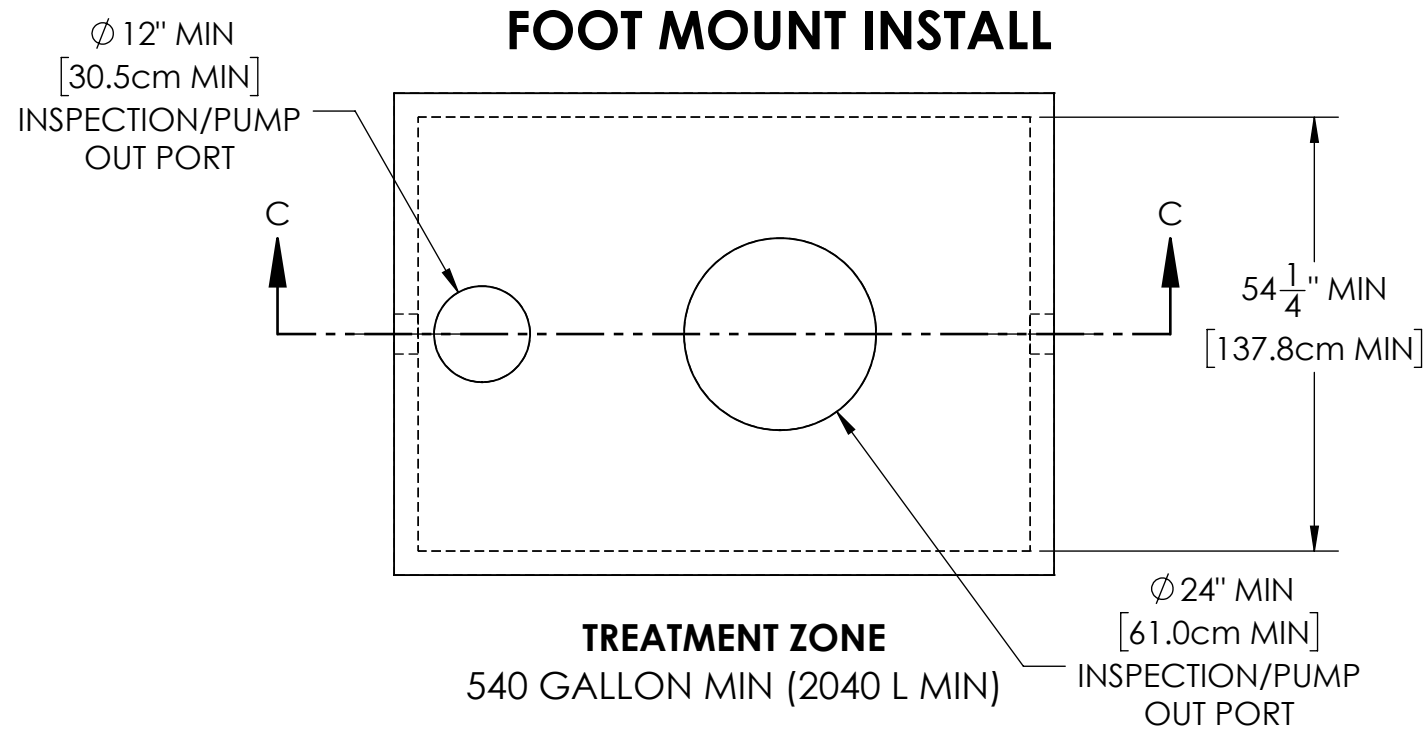



NOTES:

1. MINIMUM DIMENSIONS DO NOT DETERMINE OVERALL TANK CAPACITY.
2. INSPECTION/PUMP OUT PORT LOCATIONS MAY VARY DEPENDING ON TANK CONSTRUCTION.
3. ALL APPURTENANCES TO FAST® (E.G. TANKS, ACCESS PORTS, ELECTRICAL, ETC.) MUST CONFORM TO ALL APPLICABLE COUNTY, STATE, PROVINCE, AND LOCAL PLUMBING AND ELECTRICAL CODES.
4. PUMP OUT ACCESS SHALL BE ADEQUATE TO THOROUGHLY CLEAN OUT TANK.
5. IF LESS THAN THE SPECIFIED MINIMUMS ARE CONSIDERED NECESSARY, CONSULT FACTORY FOR GUIDANCE.
6. SPECIALIZED TREATMENT NEEDS MAY REQUIRE SPECIFIC FEATURES TO BE INCORPORATED INTO THE DESIGN. CONSULT FACTORY FOR GUIDANCE.
7. MINIMUM OF 2.0in (5.1cm) INVERT IS NECESSARY BETWEEN THE INLET AND OUTLET OF THE TANK OF GRAVITY FLOW SYSTEM
8. TANK VOLUMES MAY VARY BY APPLICATION AND JURISDICTION.
9. NITRIFAST UNITS CAN GO INTO OTHER THAN SHOWN TYPES OF TANKS, NON RECTANGULAR, PLASTIC, ETC.

PROPRIETARY AND CONFIDENTIAL		UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES AND TOLERANCES ARE AS FOLLOWS		 BETTER WATER. BETTER WORLD.	
THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF BIOMICROBICS, INC.. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF BIOMICROBICS, INC. IS PROHIBITED.		X° ±1° .X ± .50 .XX ± .25			
		DRAWN BY: CTD		DESCRIPTION TANK DETAIL DIMENSIONS	
DO NOT SCALE DRAWING		DATE: 5/27/2021			
		SHEET 5 OF 6		PART NUMBER 600-FINNTF0.75	
SCALE: 1:32		APPROVED BY: MSH		REV C	
SIZE: B		APPROVED DATE: 5/27/2021			

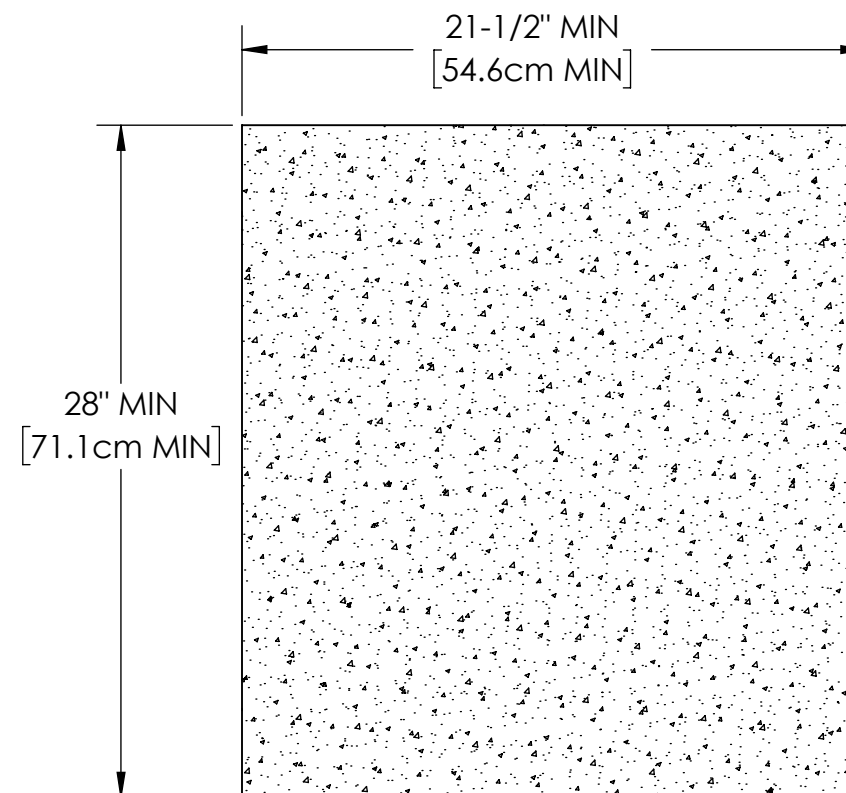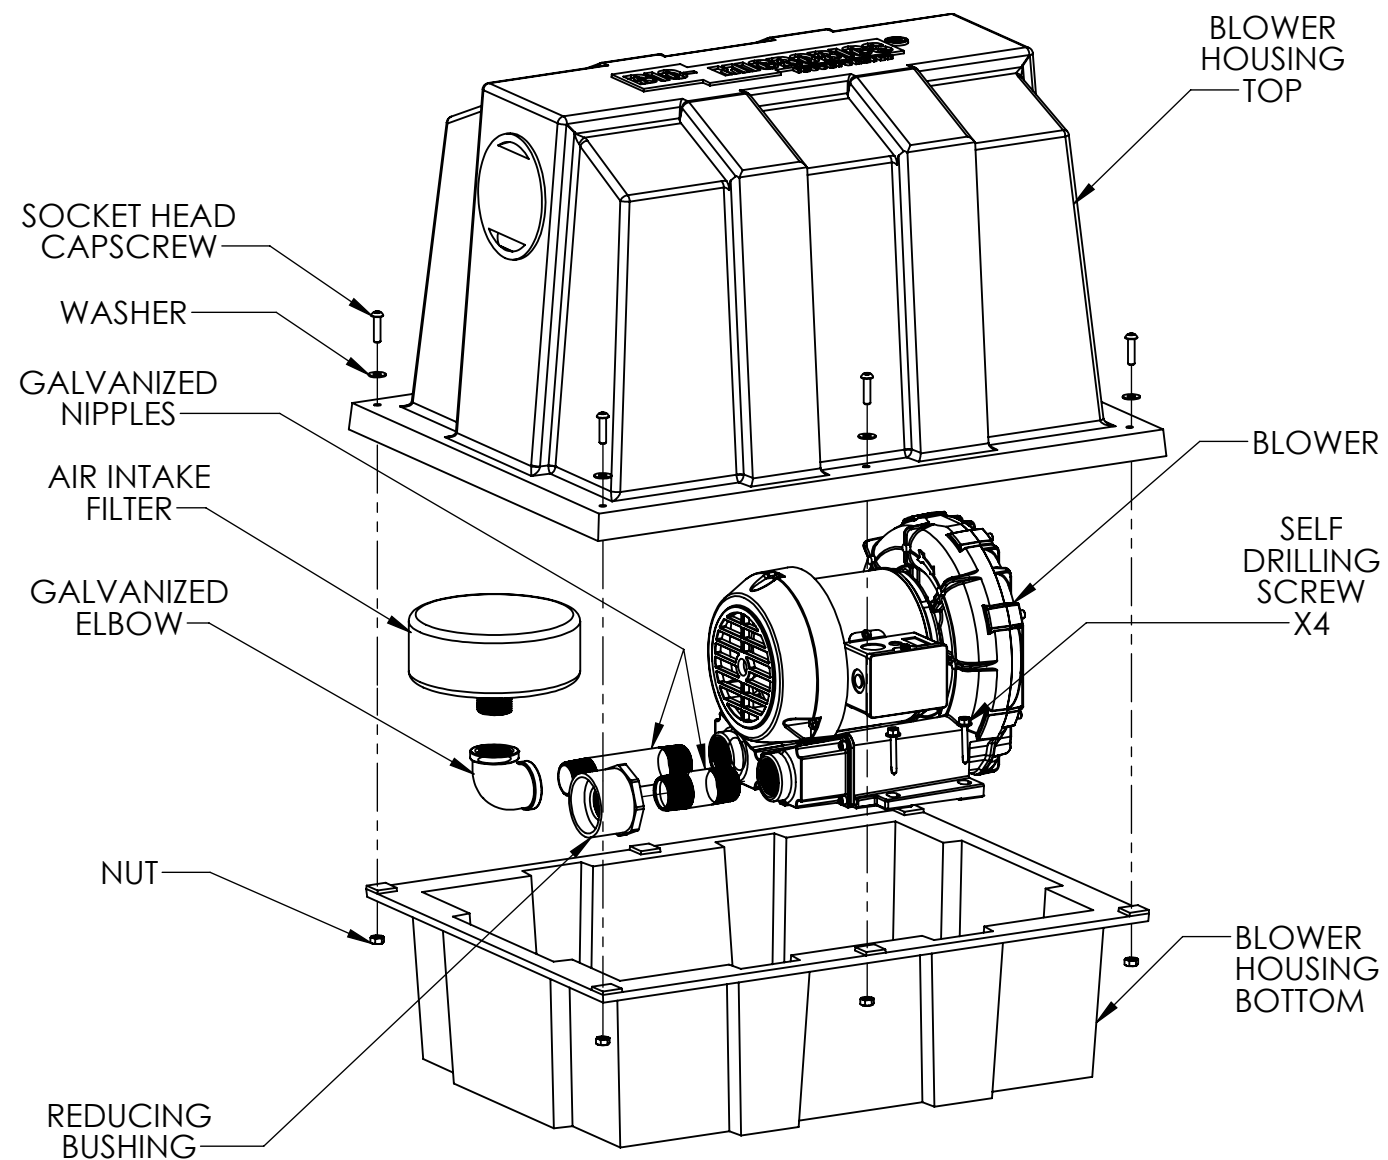


BLOWER PAD

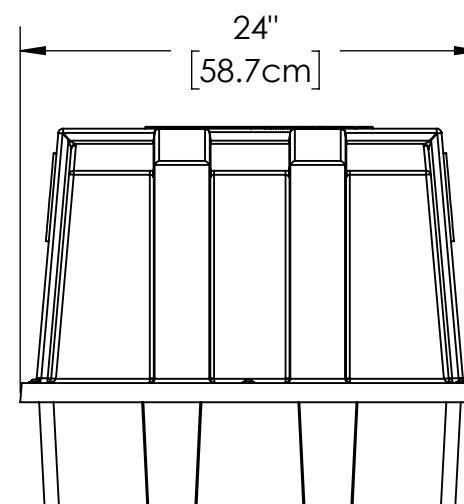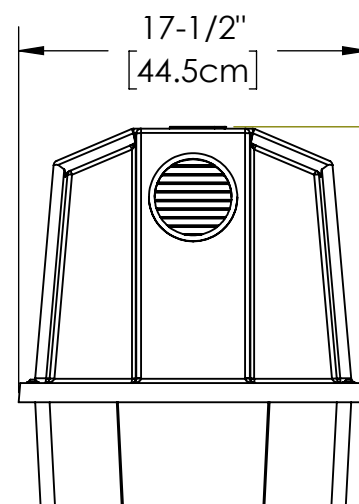

NOTES:

1. SOME NITRIFAST CONFIGURATIONS MAY REQUIRE DIFFERENT BLOWER HOUSINGS.
2. BLOWER MUST BE LOCATED ABOVE FLOOD LEVELS.

PROPRIETARY AND CONFIDENTIAL THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF BIOMICROBICS, INC.. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF BIOMICROBICS, INC. IS PROHIBITED. DO NOT SCALE DRAWING		UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES AND TOLERANCES ARE AS FOLLOWS X° ± 1° .X ± .50 .XX ± .25	
DRAWN BY: CTD		DATE: 5/27/2021	
SHEET 6 OF 6		APPROVED BY: MSH	DESCRIPTION SMALL BLOWER HOUSING AND PAD DETAIL
SCALE: 1:32	SIZE: B	APPROVED DATE: 5/27/2021	PART NUMBER 600-FINNTF0.75
			REV C